



- I THE RAMP SHALL HAVE A 12" WIDE BORDER WITH 1/4" GROOVES APPROX. 3/4" O.C.
- II WHEN RAMP IS LOCATED IN CENTER OF CURB RETURN, IT SHALL BE GROOVED WITH A TEMPLATE IN A HERRINGBONE PATTERN WITH 1/4" GROOVES, 1 1/2" O.C. GROOVES SHALL BE ALIGNED PARALLEL TO CROSSWALK TO DIRECT BLIND PEDESTRIANS INTO APPROPRIATE CROSSWALK. HERRINGBONE PATTERN SHALL NOT DIRECT BLIND PEDESTRIANS IN A DIRECTION WHICH IS AN UNSAFE CROSSING.

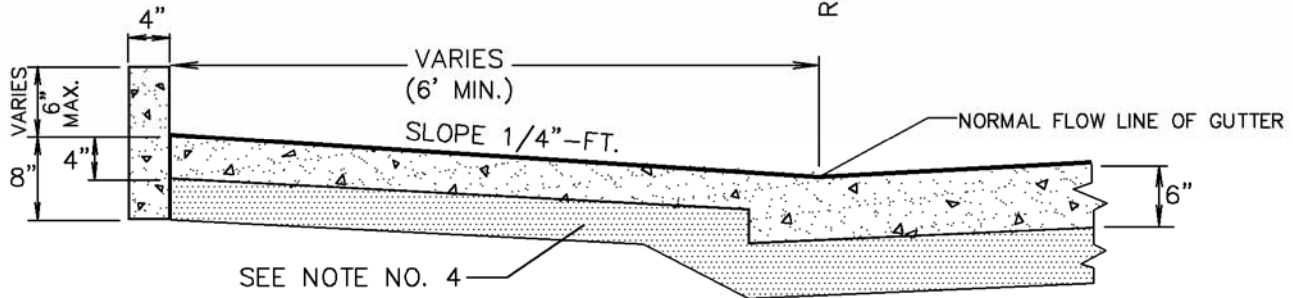

SECTION A - A

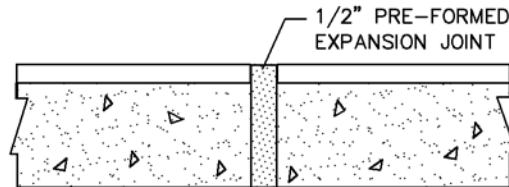

1/2" EXPANSION JOINT

NOTES:

1. CONCRETE WORK SHALL BE 2500 P.S.I. DESIGN (5 SACK MIX), 4" MAXIMUM SLUMP.
2. ALL CONCRETE SHALL HAVE A LIGHT BROOM FINISH, EXCEPT AS NOTED.
3. EXPANSION JOINT AT END OF CURVE AND BEGINNING OF CURVE OF RETURN.
4. REFER TO CITY STANDARD PLAN C-13.
5. FINISHED SURFACES SHALL BE TREATED WITH CLEAR CURING COMPOUND COMPLYING WITH SECTION 201-4 OF THE STANDARD SPECIFICATIONS.
6. TRANSITIONS FROM RAMPS TO WALKS, GUTTERS OR STREET SHALL BE FLUSH & FREE OF ABRUPT CHANGES.
7. REPAIRS SHALL BE MADE BY REMOVING & REPLACING THE ENTIRE UNIT BETWEEN JOINTS.